

President & CEO
Lorraine Grillo

Board of Trustees
Chancellor Dennis M. Walcott, Chairman
Curtis A. Harris
Emily A. Youssef



Architecture & Engineering

E. Bruce Barrett, R.A. LEED A.P., Vice President
Elan R. Abneri, P.E., Director, Design Consultant Management
Stanley Dohr, R.A., Director, Quality Control & Construction Support
Maria A. Gomez, P.E., LEED A.P., Director, A&E In-House Design
George D. Roussey, P.E., LEED A.P., Director, Technical Standards
Stacey Spann-Thom, Director, Operations Support

Consultants:

CONSULTING ENGINEERS, INC.
MECHANICAL, ELECTRICAL, PLUMBING
& FIRE PROTECTION
375 MAIN STREET TEL (201) 678 2224
HACKENSACK, N.J. 07601 FAX (201) 678 1860


NOTE: Drawing may be printed at reduced scale

IT IS A VIOLATION OF THE STATE EDUCATION LAW SECTION 7209 (2) FOR ANY PERSON TO ALTER AN ITEM IN ANY WAY UNLESS SUCH PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, AND THE ENGINEER STAMPS SUCH CHANGES

06/05/15 ISSUE FOR BID

No.	Date	Revision

Key Plan:

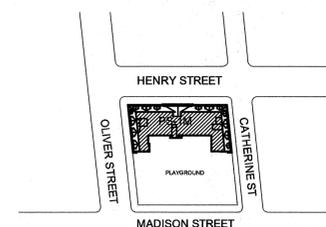

BLOCK # 279

LOT # 40

SCA Design Manager:	R. GOIK	
Project Architect/Engineer:	H. MENA, P.E.	
Discipline Lead:	H. MENA, P.E.	
Designer:	C. LARA	
Drawn by:	C. LARA	
Checked by:	H. MENA, P.E.	
Design No.:	Facility Code:	Date:
D015391	M001	06/05/2015

Project:
**PS 001 MANHATTAN
FIRE ALARM SYSTEM
UPGRADE.**

Address:
8 HENRY STREET
MANHATTAN, NY 10038

Drawing Title:
**FIRE ALARM SYSTEM THIRD FLOOR
PLAN**


Drawing No.:
FA104.00

Sheets in Contract Set:
51 of 57

Sheets in DOB Set:
of

PLAN NOTES:

- FOR GENERAL NOTES, SYMBOL LIST, ABBREVIATIONS AND FIRE ALARM SYSTEM DRAWING LIST REFER TO DWG FA001.00.
- FOR EXACT LOCATION AND QUANTITIES OF MECHANICAL AND PLUMBING EQUIPMENT AND DEVICES REFER TO MECHANICAL AND PLUMBING DWGS.
- ALL CONDUIT PENETRATIONS THROUGH FIRE RATED PARTITIONS ARE TO BE PROVIDED WITH FIRE STOP SEALS AS REQUIRED BY CODE TO MAINTAIN FIRE RATING OF PARTITIONS.
- UNLESS OTHERWISE NOTED ON DRAWING MOUNTING HEIGHTS OUTLETS AND EQUIPMENT SHALL BE AS INDICATED ON SYMBOL LIST & SPECIFICATIONS.
- CENTERLINE ELEVATION FOR ALL SPEAKER AND/OR STROBE UNITS TO BE LOCATED 8'-0" ABOVE FLOOR OR 6" BELOW THE CEILING.
- CENTERLINE ELEVATION FOR ALL PULL STATIONS IS 48" ABOVE FLOOR.
- ACCESS SHALL BE PROVIDED TO EACH DETECTOR FOR PERIODIC INSPECTION, MAINTENANCE AND TESTING AS PER SECTION 907.12 OF N.Y.C. BUILDING CODE.
- UPON REMOVAL OF ANY EXISTING EQUIPMENT AND DEVICES, CONTRACTOR SHALL REPAIR (PLASTER/TILE/PAINT) THE WALL TO MATCH EXISTING.

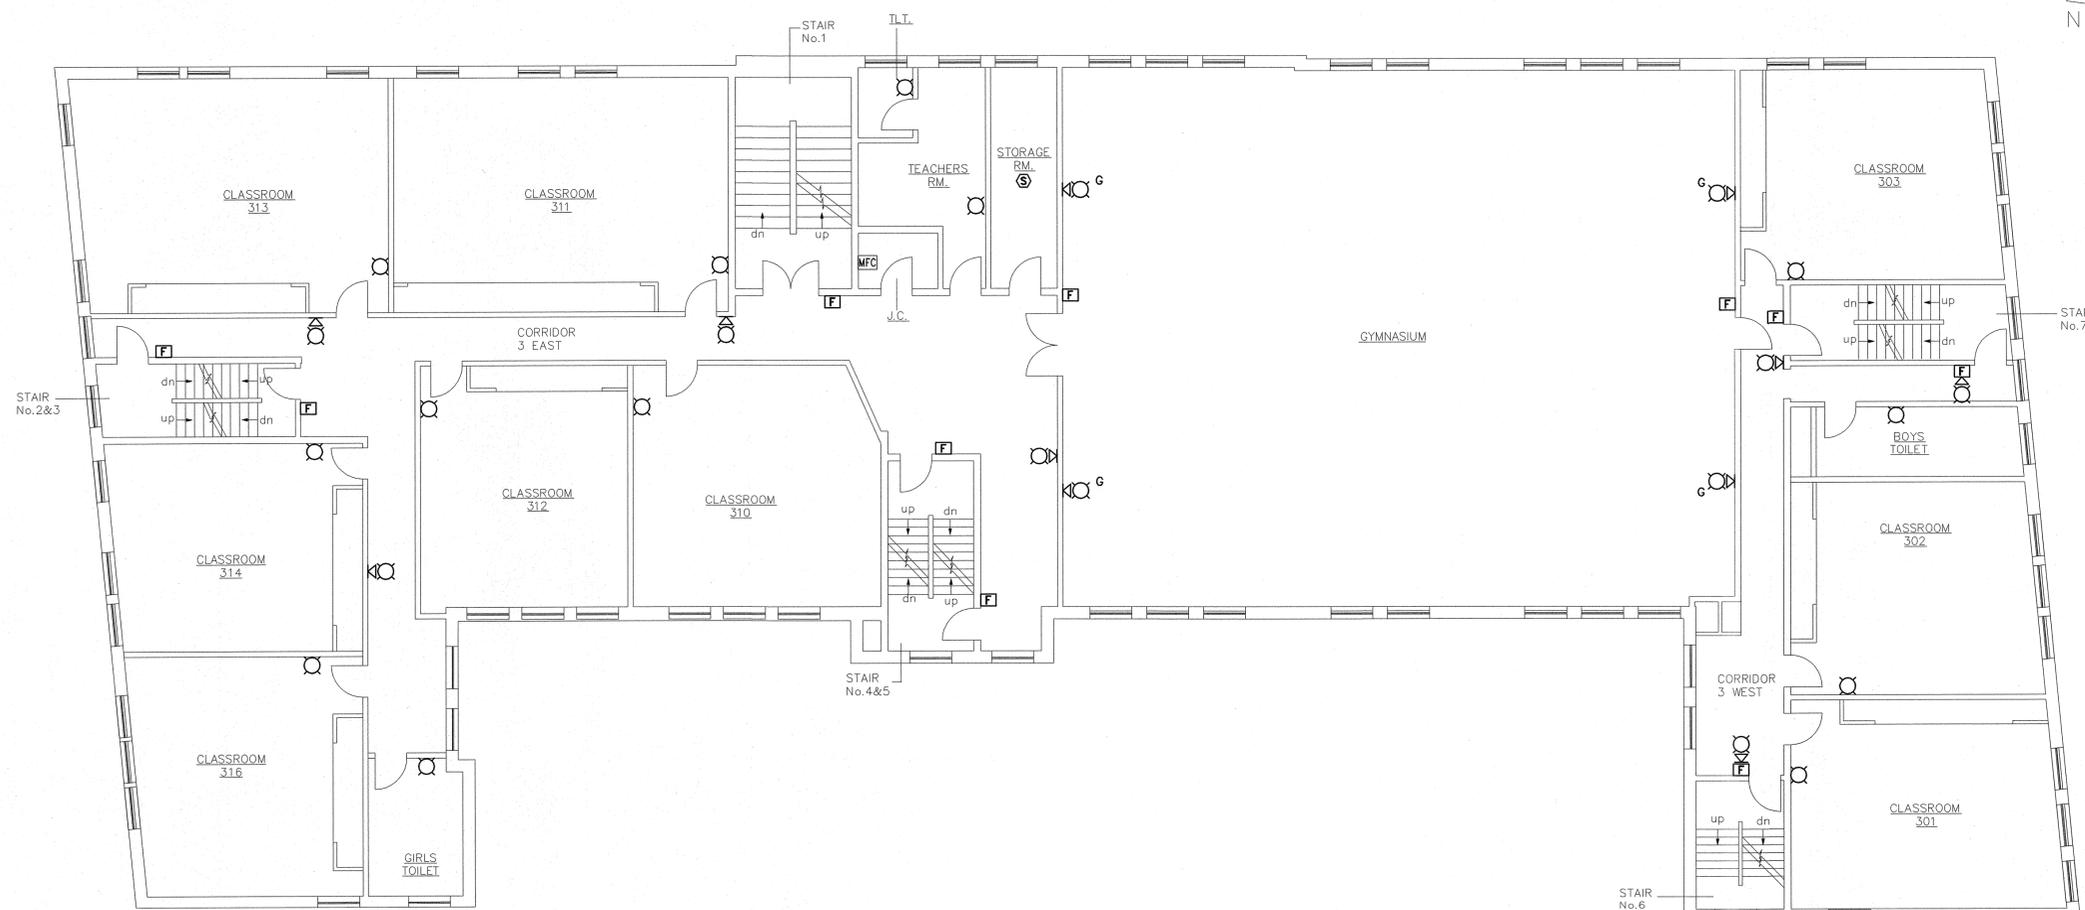

THIRD FLOOR PLAN
SCALE: 1/8" = 1'-0"